


120 VAC PLC Layout and Service Components

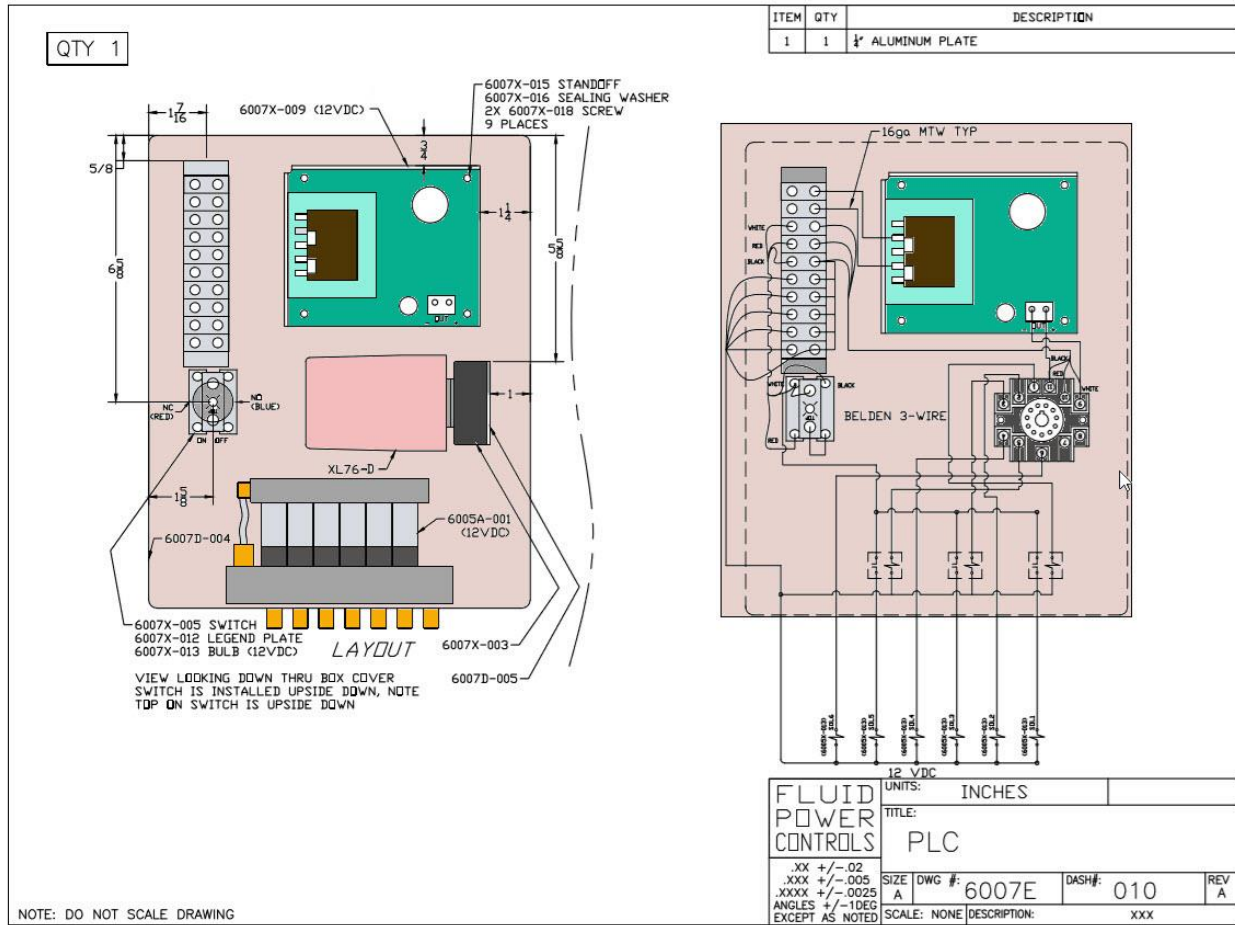

Part Number	Qty	Description	Note
XL76-D	1	Microprocessor	Call for Programming
6005A-001	As Required	12 VDC Solenoid Valve	
6007X-003	1	Relay Base	
6007D-005	1	Relay Mounting Base	
6007X-005	1	On/Off Switch	Specify Voltage
6007X-009	1	Industrial Power Supply	

For components not listed or shown contact Dry Air Systems @ (314) 344-1114